


PIPE TO STRUCTURE COLLAR

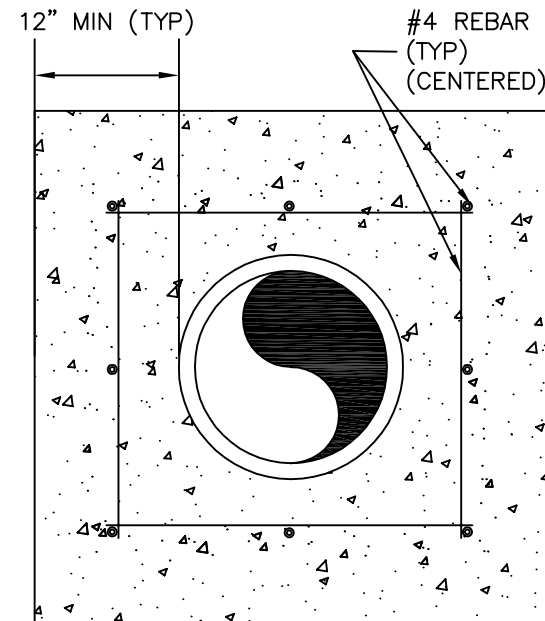


COLLAR SECTION A

NOTES

1. SEE SHEET SD-01 FOR SPECIFICATIONS AND ADDITIONAL NOTES/DETAILS.
2. IF A KNOCK-OUT IS USED, THE COLLAR SHALL COVER THE ENTIRE SIDE OF THE STRUCTURE.
3. CONCRETE FOR COLLARS SHALL BE VIBRATED.
4. COLLARS SHALL BE FORMED. AFTER COMPLETION OF COLLARS, FORMS SHALL BE REMOVED.
5. EPOXY SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
6. 2" MIN COVER FOR DOWELS IN ALL DIRECTIONS.
7. ALL CONCRETE SHALL MEET THE REQUIREMENTS SPECIFIED IN SECTION 03000 AND 03300. NO BAG MIX. BATCH PLANT ONLY.

NOT TO SCALE

1	TS	CREATED	6/2017	 HEART OF THE WASATCH	STANDARD DETAIL PUBLIC UTILITIES SD-06 PIPE TO STRUCTURE COLLAR
NO.	AUTHORIZED BY	REVISIONS	DATE		